



Carlin[®]
Combustion Technology, Inc.

Model 48245 with Smart Ignition – CAD Cell Oil Primary Control Data Sheet



- Intermittent Duty when you need it, Ignitor-saving Interrupted Duty when you don't
- Oil Pump Bleed Assist 60 seconds
- Recycle on Flame Failure
- Diagnostic LEDs
Status, lockout, flame
- 45 or 15 second TFI
- Increased Flame Accuracy
- Thermostat/Aquastat Compatible
- Improved SMC Technology
zero bleed voltage during standby
- Works Well with Generators
Insensitive to frequency changes

Power input (from limit circuit)	120 VAC, 60 HZ
Motor load	10 FLA / 60 LRA
Ignitor load	120 VAC, 60 HZ, 500 VA
Operating temperature limits	+32°F to +140°F

Storage temperature limits	-40°F to +185°F
Thermostat anticipator current	0.1 A, AC
CAD cell resistance (with flame)	R < 1500 OHMS
Agencies	UL recognized (US & Canada)

Installing and Wiring

WARNING 48245 control must be installed and serviced only by a qualified service technician.

1. Always disconnect power source before wiring to avoid electrical shock or damage to the control. All wiring must comply with applicable codes and ordinances.
2. Thermostat terminals (T-T) provide a current source. Never apply external power to these terminals under any circumstances.

Mounting

- The control may be mounted on a 4" x 4" junction box in any convenient location on the burner, furnace or wall. The location must not exceed the ambient temperature limit, 140°F.

Wiring

- Wiring must comply with local and national electrical codes, and with the wiring diagram.
- Individual or bundled neutrals may be attached to any L2 terminal.

Field checks

1. **Select preferred TFI** by 1) leave jumper in for 45 seconds or 2) remove jumper for 15 seconds. **IMPORTANT:** TFI change occurs on next call for heat.
2. **Safety timing (TFI) test** – Remove one CAD cell wire (F-F). Start burner. The control should lockout within the TFI time limit. Replace CAD cell wire.
3. **Flame failure test** – Start burner. After flame is established (after TFI period), close the oil supply hand valve. This will cause a flame failure sequence as described in the Startup & Operation section of this data sheet. Under recycle, please read “Smart Ignition” on page 3.
4. If control does not operate as described, check the wiring.

Startup & Operation

Three wire or four wire configuration

- See Figure 1 for wiring diagram for four-wire configuration (Smart Ignition)
- See Figure 2 for wiring diagram for three-wire configuration

WARNING Do not start the burner if the combustion chamber contains oil or oil vapor.



NOTICE Per UL requirements, the control will not turn on if the CAD cell senses flame during the self-test. If the CAD cell sees light (flame) at the beginning of a cycle, the control will remain in self-test mode until the CAD cell no longer senses light (flame). The amber LED will blink momentarily every 3 to 4 seconds and green LED will be on or flashing.

Model 48245 Diagnostic LEDs

Ⓐ – Amber OFF	Ⓐ – Amber ON	Ⓐ – Amber FLASHING
Ⓒ – Green OFF	Ⓒ – Green ON	Ⓒ – Green FLASHING
Ⓓ – Red OFF	Ⓓ – Red ON	Ⓓ – Red FLASHING

SEE WIRING DIAGRAM ON NEXT PAGE

Wiring

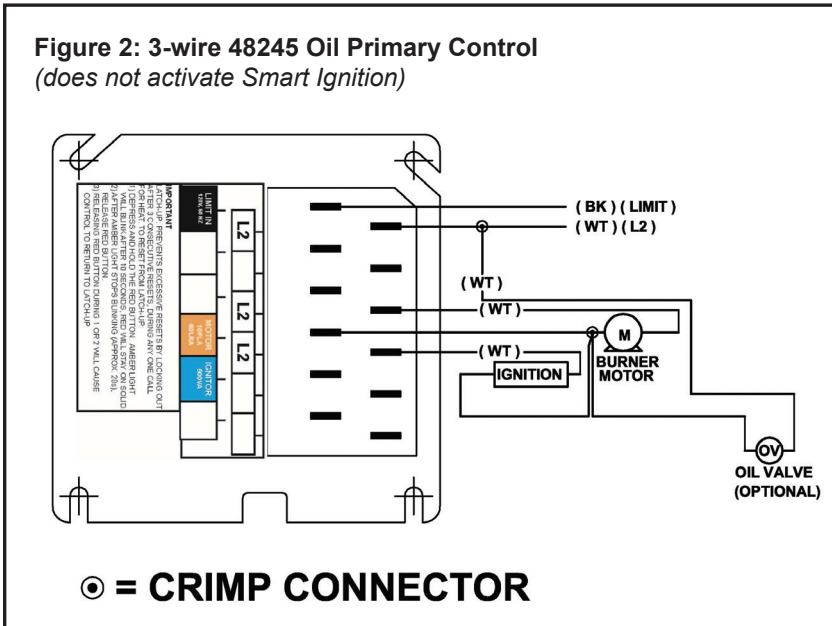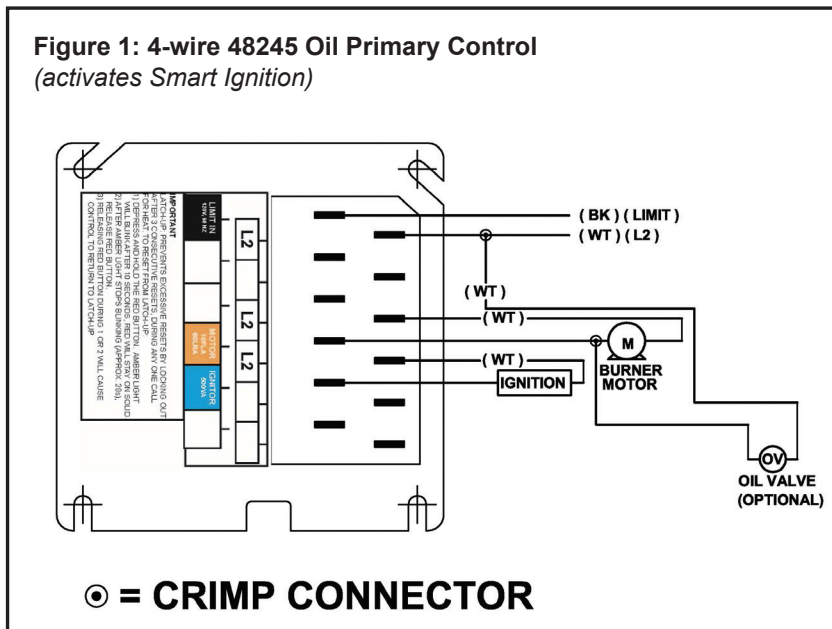

Startup & Operation Three wire or four wire configuration (continued)

- ⒶⓈⓇ **Power ON** Open all manual oil line valves. Close the line switch. (If Red LED turn on constant Ⓡ, control is in lockout. See next page to reset.)
- ⒶⓈⓇ **Self-test 1** The control performs a “boot-up” test to verify internal operation each time power is applied to the L1 wire. The amber LED turns on and the test continues for about 5 seconds. If the test fails, the control turns the amber LED off and repeats this test sequence until successful.
- ⒶⓈⓇ **Stand-by** (No call for heat) If Self-test 1 is successful, amber LED turns off and control waits for heat call.
- ⒶⓈⓇ **Call for heat** Set thermostat to call for heat. Thermostat circuit must be closed and power coming to black wire from limit circuit.
- ⒶⓈⓇ **Self-test 2** If a failure occurs in this self-check, the control won’t start and the amber LED blinks 1 second on, 4 seconds off, until serviced or the problem clears. These failures include CAD cell seeing light, internal failure, or line voltage <90V. See service section.
- ⒶⓈⓇ **Burner ON** After the self-test, amber LED turns off. The ignitor starts, followed 2 seconds later by the motor. Wired as 3-wire, the ignitor and motor come on at the same time.

Startup & Operation Four wire configuration

WARNING Do not start the burner if the combustion chamber contains oil or oil vapor.

NOTICE Per UL requirements, the control will not turn on if the CAD cell senses flame during the self-test. If the CAD cell sees light (flame) at the beginning of a cycle, the control will remain in self-test mode until the CAD cell no longer senses light (flame). The amber LED will blink momentarily **A** every 3 to 4 seconds and green LED will be on or flashing.

- A** **Power ON** Open all manual oil line valves. Close the line switch. (If Red LED turn on constant **R**, control is in lockout. See below to reset.)
- A** **Self-test 1** The control performs a “boot-up” test to verify internal operation each time power is applied to the black wire. The amber LED turns on and the test continues for about 5 seconds. If the test fails, the control turns the amber LED off and repeats this test sequence until successful.
- A** **Stand-by** (No call for heat) If Self-test 1 is successful, amber LED turns off and control waits for heat call.
Call for heat Set thermostat to call for heat. Thermostat circuit must be closed (and black wire must receive power from the limit circuit).
- A** **Self-test 2** If a failure occurs in this self-check, the control won't start and the amber LED blinks 1 second on, 4 seconds off, until serviced or the problem clears. These failures include CAD cell seeing light, internal failure, or line voltage <90V. See service section.
- A** **Burner ON** After the self-test, amber LED turns off. The ignitor starts, followed 2 seconds later by the motor.
Pump Prime To enter pump prime: 1. Start a CFH cycle. During Pre-Ignition, press Reset until motor turns off (10 seconds), then release the button. When motor turns back on, within 5 seconds, press the Reset button until the amber LED starts to flash. You are in Pump Prime, release Reset button.
Optional Pump Prime notes: 1) If Pump Prime is lost, press Reset for 1 second and release, then if the control is not in Pump Prime, restart the sequence. 2) If Reset is released before end of first 10 seconds, the control returns to Standby and restarts another CFH cycle. 3) If reset is not pressed the second time, a normal CFH cycle will continue. 4) If motor and igniter are on and amber LED is flashing, the control is in Pump Prime. 5) Pump Prime will exit standby if flame is detected, or 60 seconds has elapsed, or loss of TT or Limit, or Reset button is pressed.
- A** **TFI** The CAD cell must sense flame within the TFI time limit (trial for ignition). Insufficient flame puts control into lockout.
- A** **Run** The burner continues firing during call for heat if the CAD cell is sensing flame. Only the green LED is on during normal running.
- A** **Lockout** If CAD cell does not sense flame within the TFI time limit after the burner starts, **lockout** occurs. The control turns the red LED on constant and closes the alarm contact.
To Reset Push in and hold reset button for 2 seconds, then release.
NOTICE The 48245 control will retain lockout if power is interrupted.
- A** **Recycle (Flame Failure)** If the CAD cell loses flame signal during operation (after the TFI), the Red LED flashes. Recycle: control waits for 65 seconds, Red LED goes off, then begins again at Self Test 2.
NOTICE If the green LED is blinking during a run, the flame is weak or unstable and may go into recycle.
- A** **Stand-by** Control remains in stand-by mode until limit circuit sends power to the black wire and thermostat circuit closes (call for heat).

Smart Ignition

IMPORTANT: All four wires provided must be used to activate the Smart Ignition feature. The ignitor must be wired to the control's blue ignitor output terminal. *See Figure 1 for Smart Ignition Wiring diagram*

Smart Ignition runs in Intermittent Duty (aka “constant” duty) when needed to prevent loss of flame. But unlike any other primary control, Smart Ignition switches to Interrupted Duty when it can – to save wear and tear on the ignitor and electrodes.

How Smart Ignition Works:

The control initially works as an Interrupted Duty control. Following a 45-second Trial-for-Ignition period and a 45-second Flame Stabilization period, the ignitor output is turned off.

If flame is lost at any time after the Trial-for-Ignition period, the control will recycle (60 - 65 seconds). Following this recycle, the control will operate in Intermittent Duty mode for ten heat cycles. Following these ten cycles, the control will revert back to Interrupted Duty and will remain in Interrupted Duty until another recycle event occurs.

The Best of All Worlds:

The Model 48245 with Smart Ignition **ensures flame retention** by providing intermittent duty ignition when required to prevent flame loss and it **dramatically increases the ignitor and electrode life** and **saves energy** by switching to interrupted duty the remainder of the time.

To manually reset from Intermittent Mode: Open TT and depress the reset button until the amber LED turns on. Release the reset button; the control is reset from the intermittent mode.

Service & Troubleshooting

Burner (control) will not come on

ⓐ ⓑ ⓓ No power to control

- Check limit circuit to the control (at least 102 VAC).
- Check all electrical connections.

ⓐ ⓑ ⓓ Control is in lockout

- Red LED will be on. Press the reset button for 2 seconds.

ⓐ ⓑ ⓓ CAD cell seeing light

- Green LED on, and amber LED blinking 1 second on, 4 seconds off. Remove one yellow lead from FF terminals. If the amber LED remains flashing, the control is defective.

If the amber LED goes OFF, the control is OK, and;

- light is leaking into the burner housing, or
- CAD cell is defective, or
- there is a problem with the CAD cell wiring or holder.
- If appliance was recently shut down, CAD cell may see residual hot spots in chamber.

To troubleshoot:

- Attach multimeter to monitor CAD cell resistance. Dark resistance should be over 50K ohms, and room light resistance (control flipped open) should be at most 10K ohms. Replace cell if necessary, or reinstall and close the burner housing.
- Check for stray light by measuring the CAD cell resistance looking into the inactive combustion chamber. It should read at least 50 kohms.

ⓐ ⓑ ⓓ Other no start problems

If the CAD cell is OK, and the amber LED still blinks 1 second on, 4 seconds off, the other possible failures include:

- Line voltage <90 VAC (amber LED flashes uniquely, 1 second on, 1/2 second off, 1 second on, 3 seconds off, then repeats). *Check line voltage.*
- Internal fault. If CAD cell and line voltage are OK, the issue may be an internal fault. *Replace the control.*

Repeated flame failures (ⓐ ⓑ ⓓ flashing red LED)

Check for:

- CAD cell is defective. *Replace.*
- Air leaking into oil line causing flame out. *Check oil line connections and filter gasket.*
- Defective nozzle causing flame to be erratic. *Change nozzle.*
- Excessive airflow or draft causing flame to leave burner head. *Check for proper air band setting and draft.*
- Excessive back pressure causing flame to be erratic. *Check appliance and flue for sooting/plugging.*

Control locks out at end of TFI (ⓐ ⓑ ⓓ red LED on)

Check for:

- No oil to burner. *Check oil supply, filters, lines.*
- Shorted electrodes. *Inspect for cracked porcelain and replace as needed.*
- Poor spark. Check electrode spacing and condition per burner manual. *Replace or realign if necessary.*
- Nozzle clogged. *Replace nozzle.*
- Airflow too high. *Check air band setting.*
- Ignitor module defective. *Replace if no spark.*
- CAD cell defective
- Oil valve (if used) stuck in closed position.
- Check wiring connections.

ⓐ ⓑ ⓓ Blinking Green LED

- Weak or unstable flame.
- Check ohms.
- Check CO₂ level.

NOTICE

FROZEN PIPES/WATER DAMAGE: This is not a freeze protection device. Suitable freeze protection monitoring or other precautions are recommended to protect against ruptured pipes/water damage caused by fuel outage, safety related fault conditions, or equipment failures.